

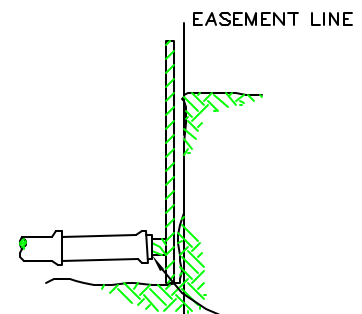


- NOTES: 1) MINIMUM DEPTH AT EASEMENT LINE SHALL BE 4 FEET OR AS SPECIFIED.
- 2) MARKER POSTS AND BLOCKING SHALL BE A PRESSURE TREATED 2x4 - POST SHALL EXTEND 12" ABOVE FINISH GRADE AND EXPOSED AREA SHALL BE PAINTED WHITE
- 3) GLUE ON OR SOLVENT WELDED PLUGS SHALL NOT BE PERMITTED

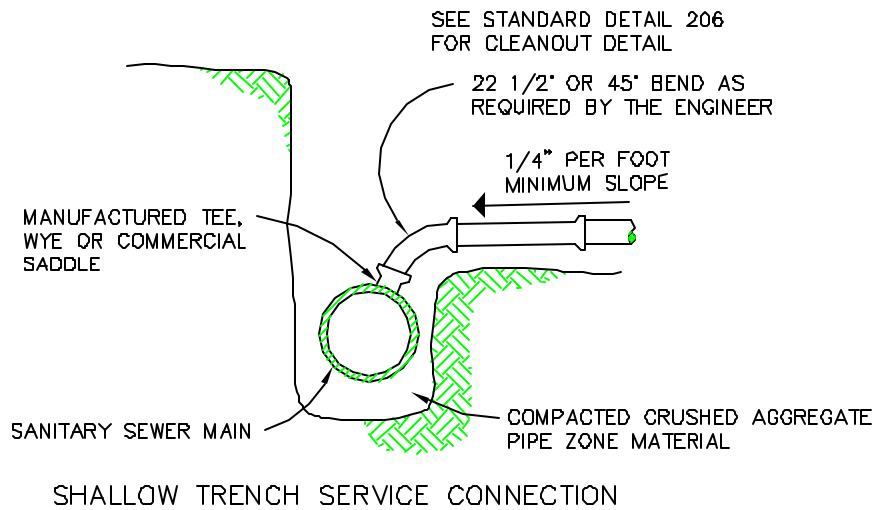


REMOVABLE WATERTIGHT PLUG, BLOCKING AND MARKER POST IF LEFT UNCONNECTED (SEE NOTE 3)

EASEMENT LINE MARKER POST DETAIL

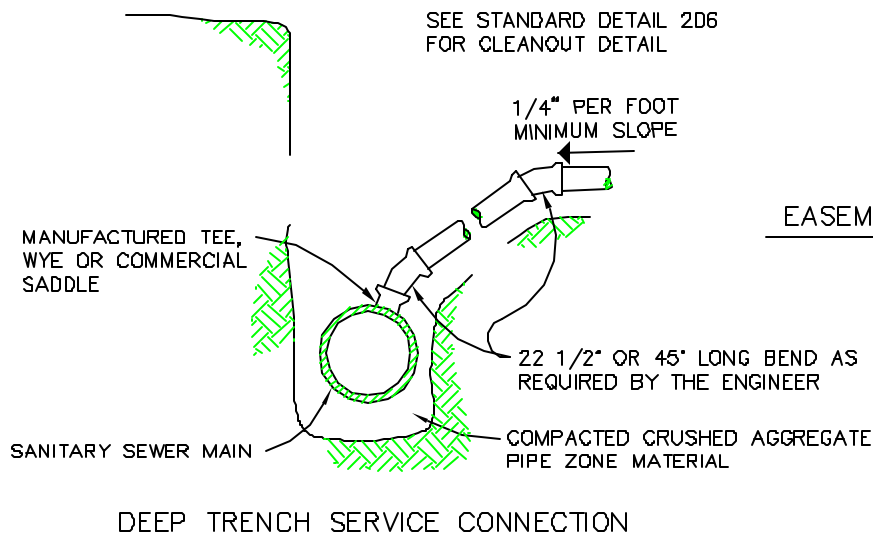

NOTE: WHERE TEE OR WYE IS LOCATED IN STREET RIGHT-OF-WAY EXTEND SERVICE CONNECTION TO RIGHT-OF-WAY LINE AND INSTALL CLEANOUT AS PER STANDARD DETAIL 206

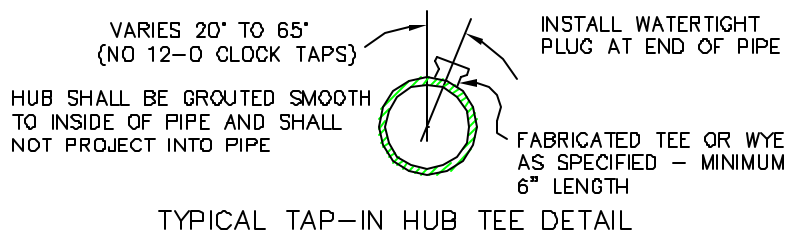

CITY OF CORVALLIS

ENGINEERING DIVISION

STANDARD PIPING DETAILS

DATE: JANUARY, 2003

SCALE: NONE

STANDARD DETAIL No.

APPROVED:

206A